
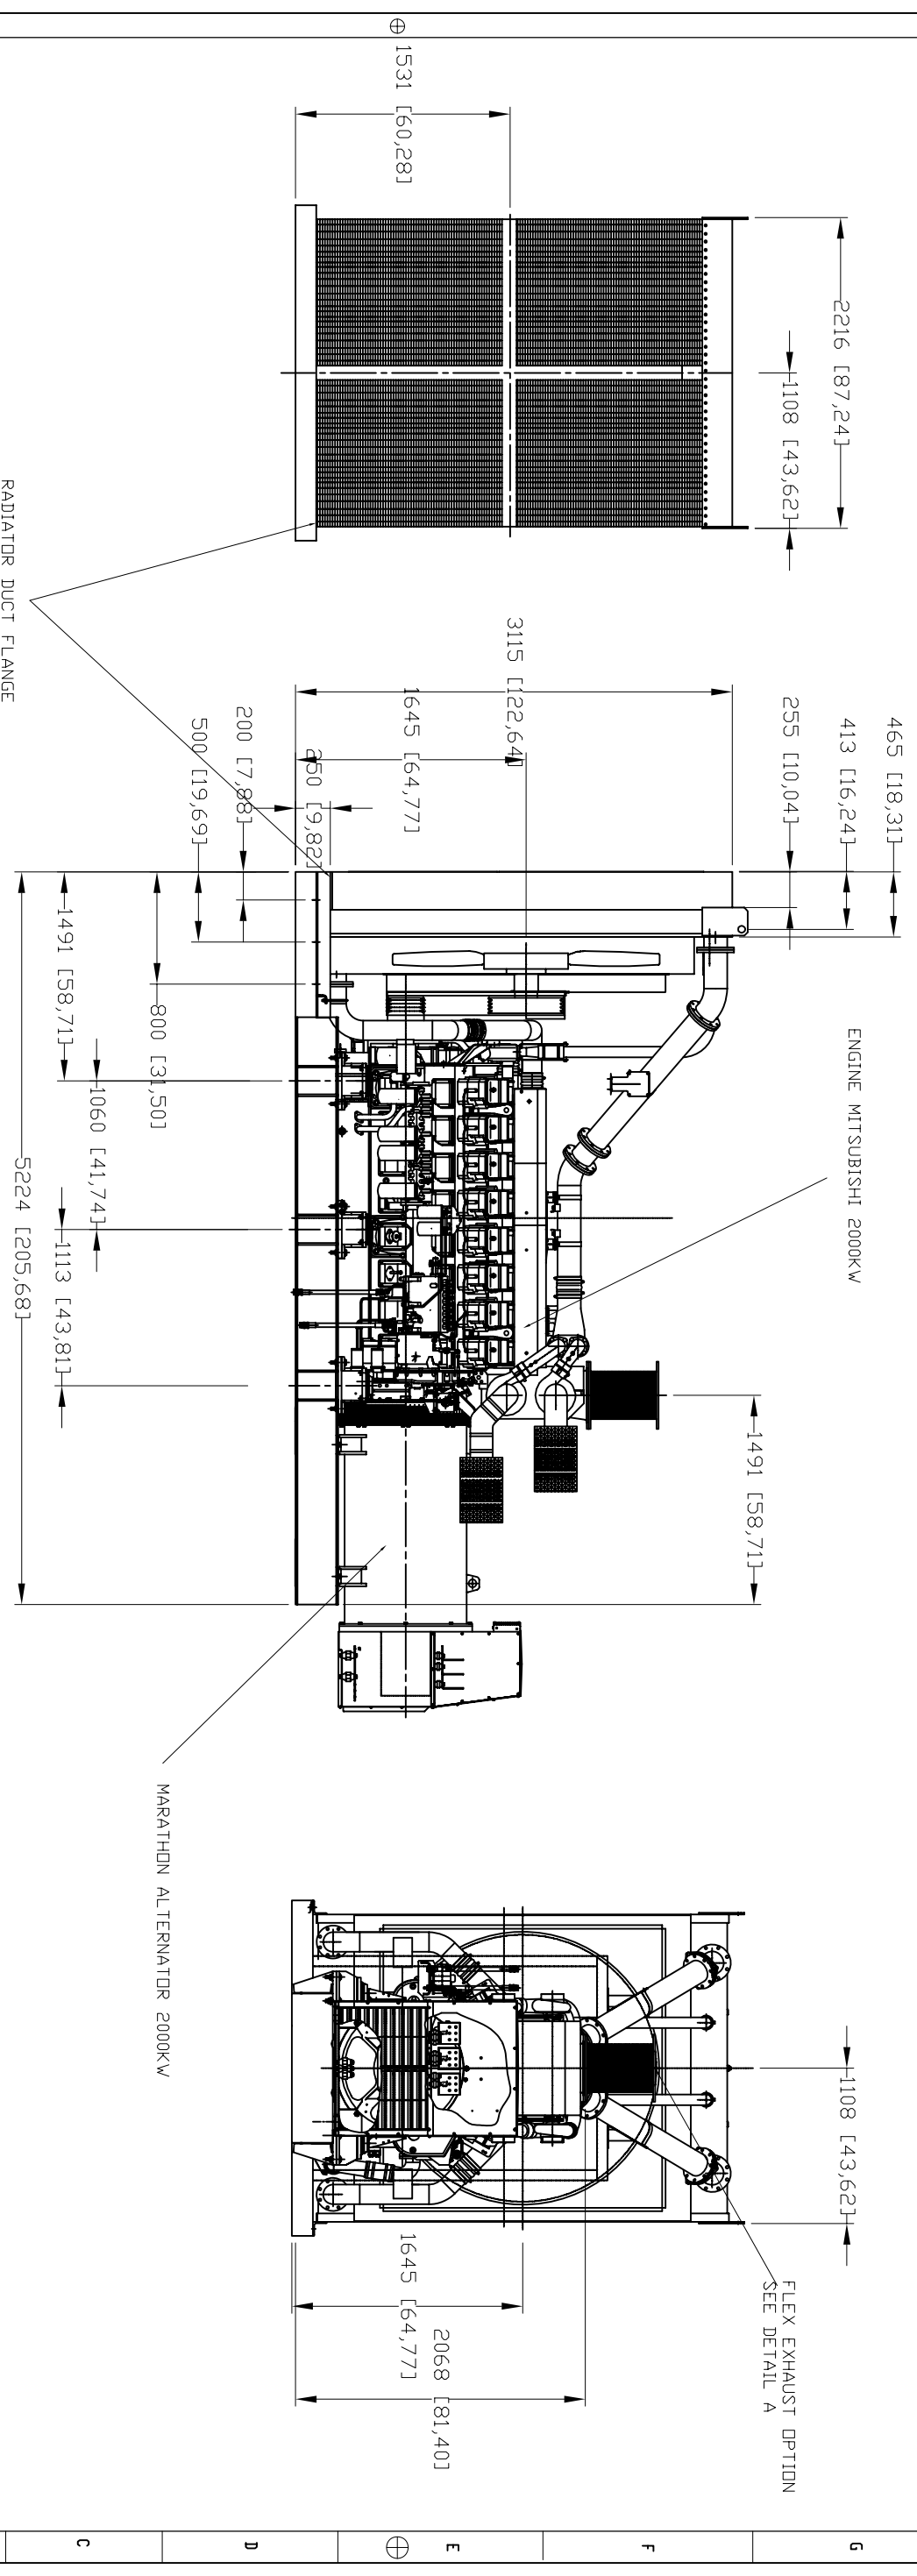


GENSET 2000KW GENERAL FEATURES WITH CHASSIS					
ASSEMBLY NUMBER	CAPACITY KW	ENGINE MODEL	MARATHON ALTERNATOR MODEL	WEIGHT IN LBS/KG	FUEL CONSUMPTION WITH LOAD IN LBS/KW AND ENGINE POWER: at 75% at 100%
GS-M-2000LKM	2000	S16R-Y1P1AA2-1	Z44RS1-4058	2813.5	381.9

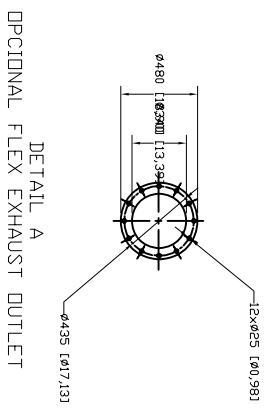

FD-G1-01-02 REV.02

COPY CONTROLLED

COPY NOT CONTROLLED

OBSOLETE DATE

DATE: 24-05-07
REV. NUMBER: GSMT12000M

SHEET 1675

APPLICATE STANDARD	REVIEW
NDRM	

NOTE: DIMENSIONS IN [] ARE INCH

DESCRIPTION	REVIEW NUMBER	NUMBER OF CHANGE	DATE	REVIEW
LIST OF REVISIONS				

MATERIAL	PART NUMBER	WEIGHT (KG)	FINISH	NOT FINISH	OTHER
NA	NA	NA	NA	NA	NA

MANUFACTURING TOLERANCE	DECIMAL	LINEAR	DIAMETER	ANGULAR
RANGE: 0 mm - 200 mm	± 0.1 mm	± 0.15	± 0.05	No. DIM
200 mm - 1200 mm	± 0.2 mm	± 0.20	± 0.05	90° ±
1200 mm - 10000 mm	± 0.3 mm	± 0.30	± 0.05	DIM

FRACCIÓN	APPROVE WITH GAUGE
3	± 0.05



THE INFORMATION CONTAINED IN THESE DOCUMENT IS PROPERTY EXCLUSIVE OF MAQUINARIA ISGA. THEREFORE, THE TOTAL OR PARTIAL REPRODUCTION WITHOUT NOT CONSENT CANNOT WRITING BE USED BY MAQUINARIA ISGA S.A DE C.

MAQUINARIA ISGA S.A. DE C.V.
GENERAL ADJUSTMENT GENSET 2000 KW



DATE: 24-05-07
REV. NUMBER: GSMT12000M

APPROVED BY: [Signature]

1 2 3 4 5 6 7 8 9 10 11 12

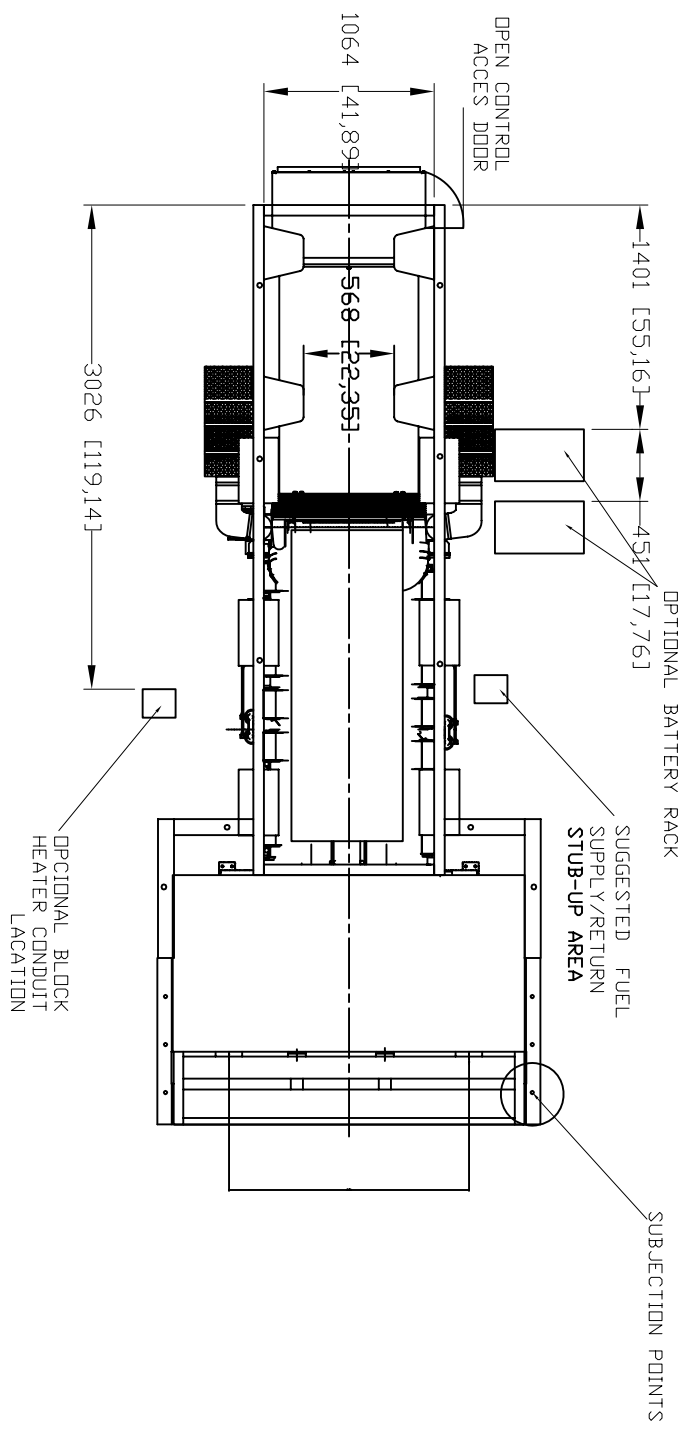

INSTALLATION NOTE
 IF SUBBASE FUEL TANK AND/OR SOUND HOUSING IS USED, REFER TO SUBBASE FUEL TANK ADV TO DETERMINE MOUNTING LOCATIONS

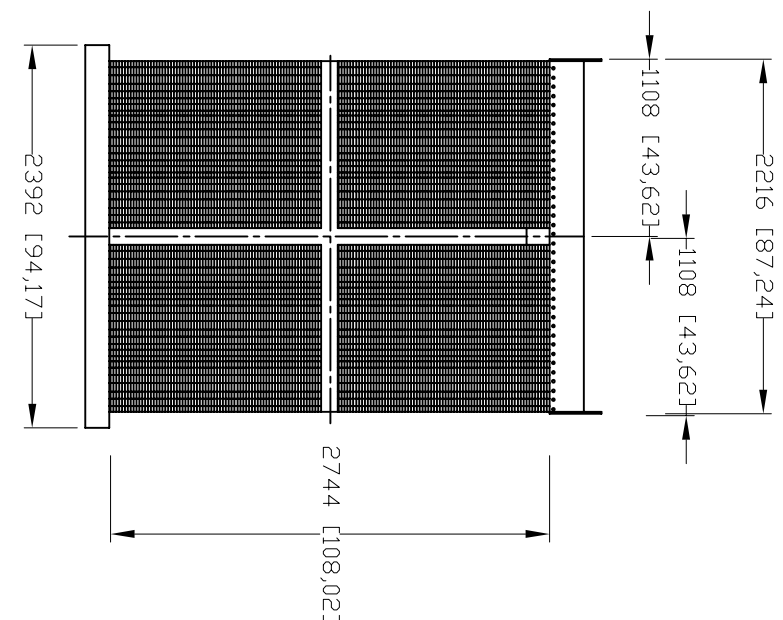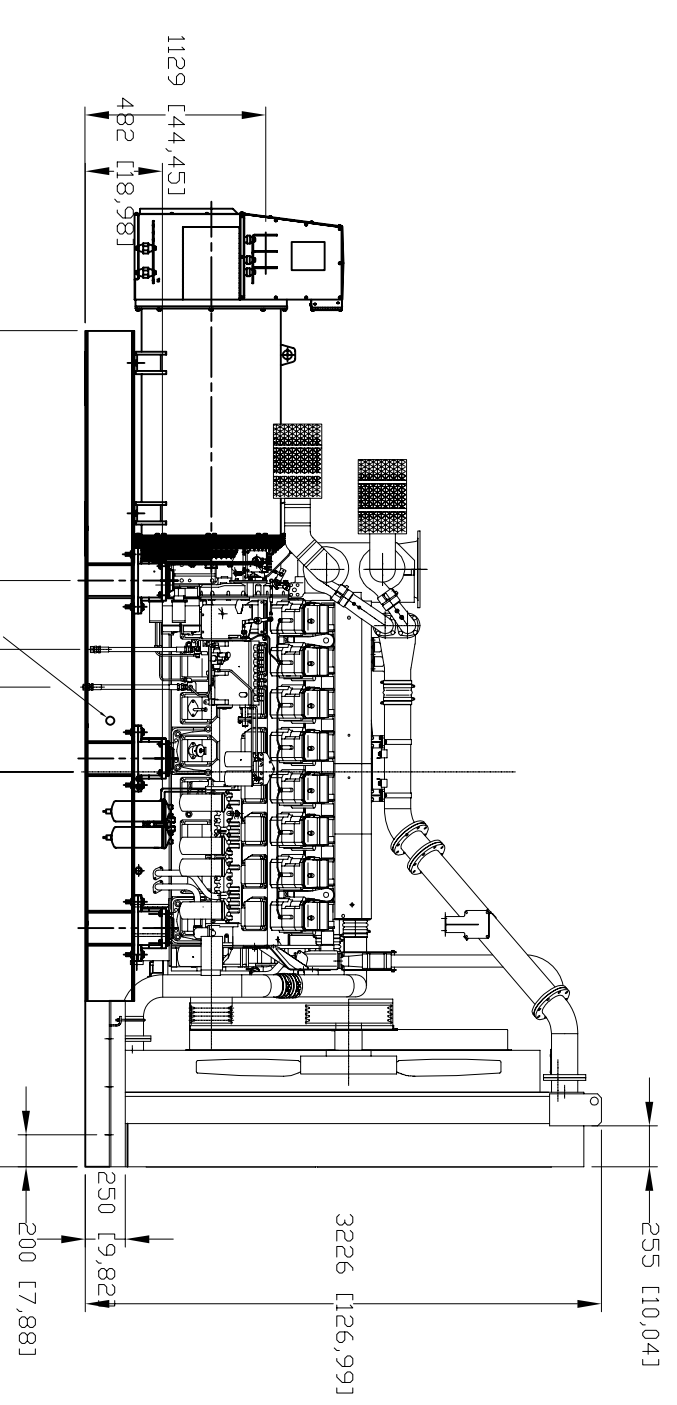

APPLICATE STANDARD	REVIEW
NORM	

NOTE: DIMENSIONS IN [] ARE INCH

DESCRIPTION	REVIEW NUMBER	CHANGE	DATE	REVIEW
LIST OF REVISIONS				
2000 kW 60HZ/40C COOLING S16R-Y1P1AA2-1 SERIES MITSUBISHI TIER 1				

MATERIAL	PART NUMBER	WEIGHT (kg)	FINISH	NOT FINISH	CUSTOMER
NA	NA	NA	NA	NA	MAQUINARIA IGSA S.A. DE C.V.
STANDARD TOLERANCES OF NOT SPECIFY OTHER					
MANUFACTURING NOT TOLERANCES		MANUFACTURING TOLERANCE		ANGULAR	
RANGE	TOLERANCES	DECIMAL	LINEAR	DIAMETER	No. DIM
0 mm - 200 mm	± 0.1 mm	0	± 0.12	± 0.08	90° ±
200 mm - 1200 mm	± 0.2 mm	0	± 0.15	± 0.10	± 1
1200 mm - 2000 mm	± 0.3 mm	0	± 0.20	± 0.12	
2000 mm - 10000 mm	± 0.5 mm	0	± 0.30	± 0.15	
FRACTION		ANGULAR		WITH GAUGE	
± 1/100 mm		± 1		± 0.1	

FD-G1-01-02 REV.02

COPY CONTROLLED

COPY NOT CONTROLLED

OBSOLETE DATE

MAQUINARIA IGSA S.A. DE C.V.
 GENERAL ADJUSTMENT GENSET 2000 KW
 SCALE: 1:10
 DATE: 21-05-07
 DRAWN: RLR
 REVIEW: MCE RLR
 APPROVED: MCE RLR
 SHEET: 4 OF 5